

Figure 1

CMTS 104

CABLE  
MODEM 105

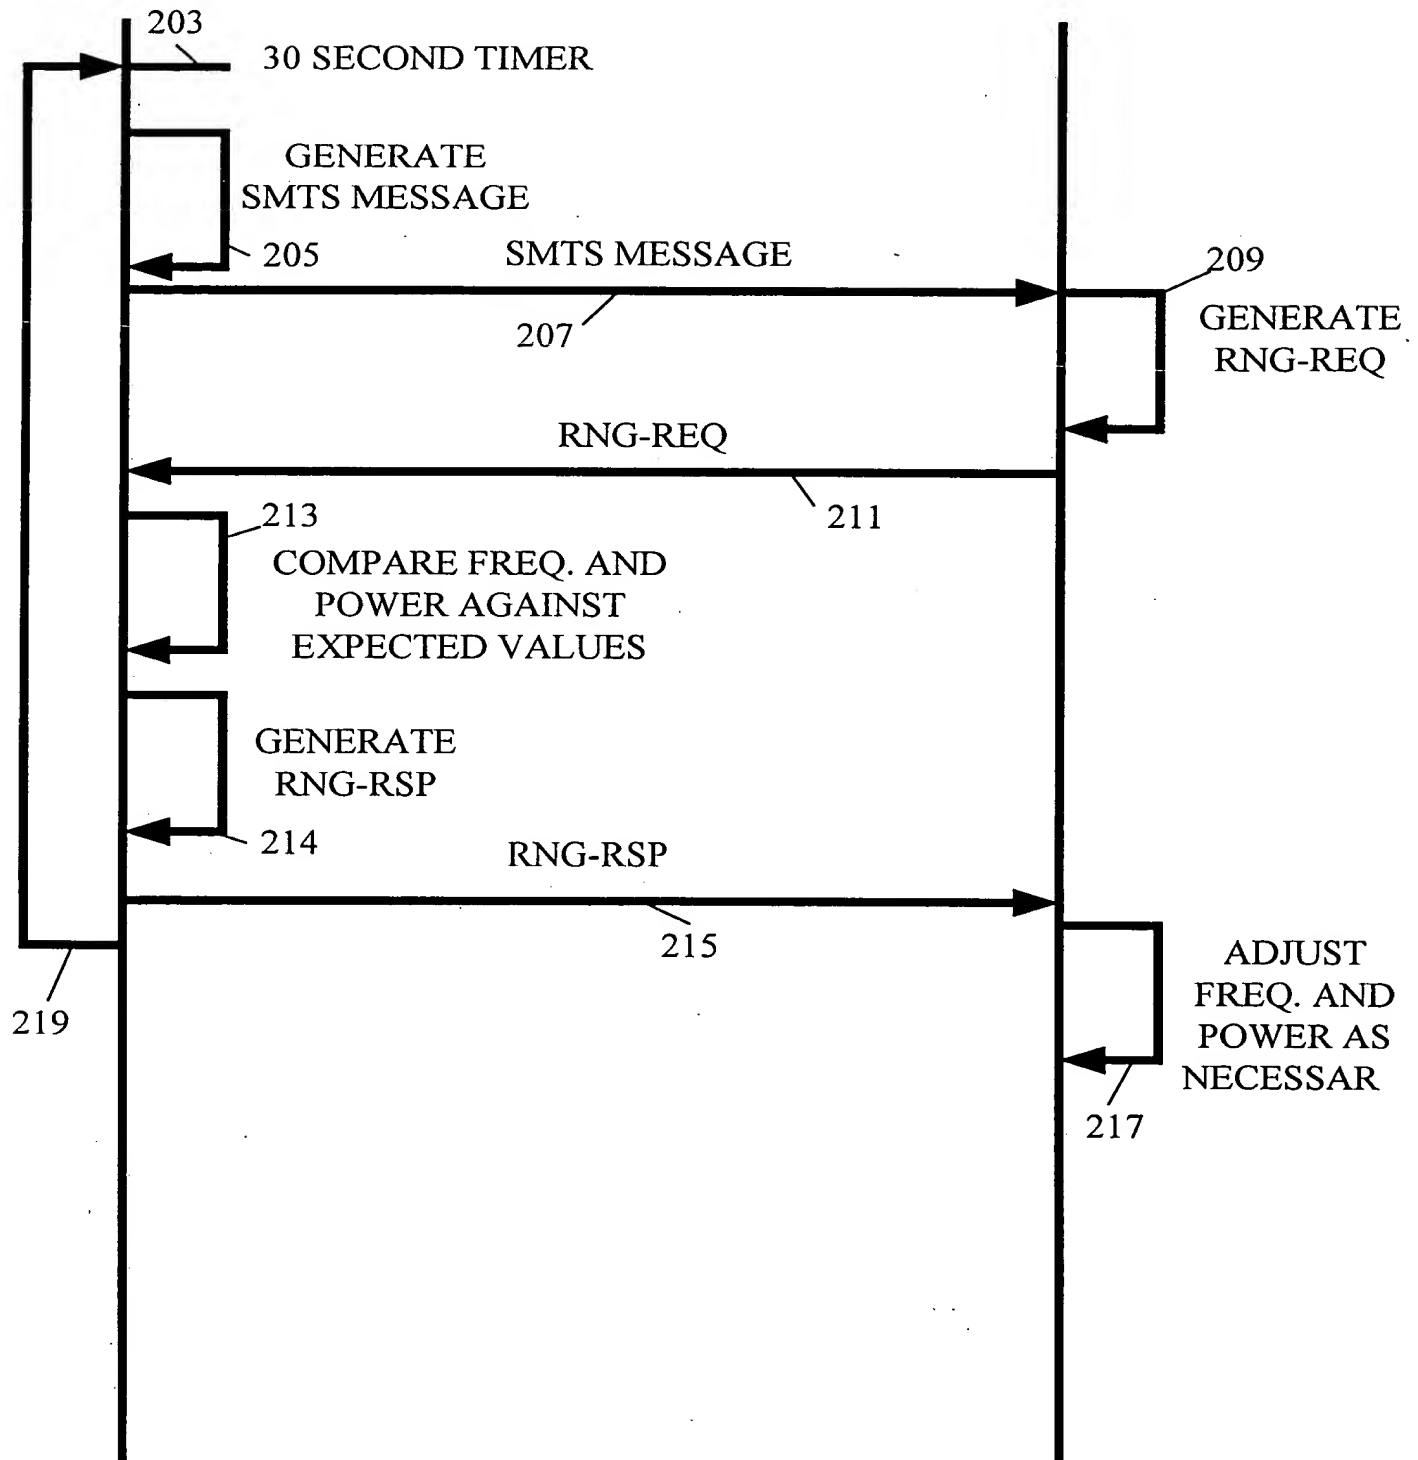


Figure 2



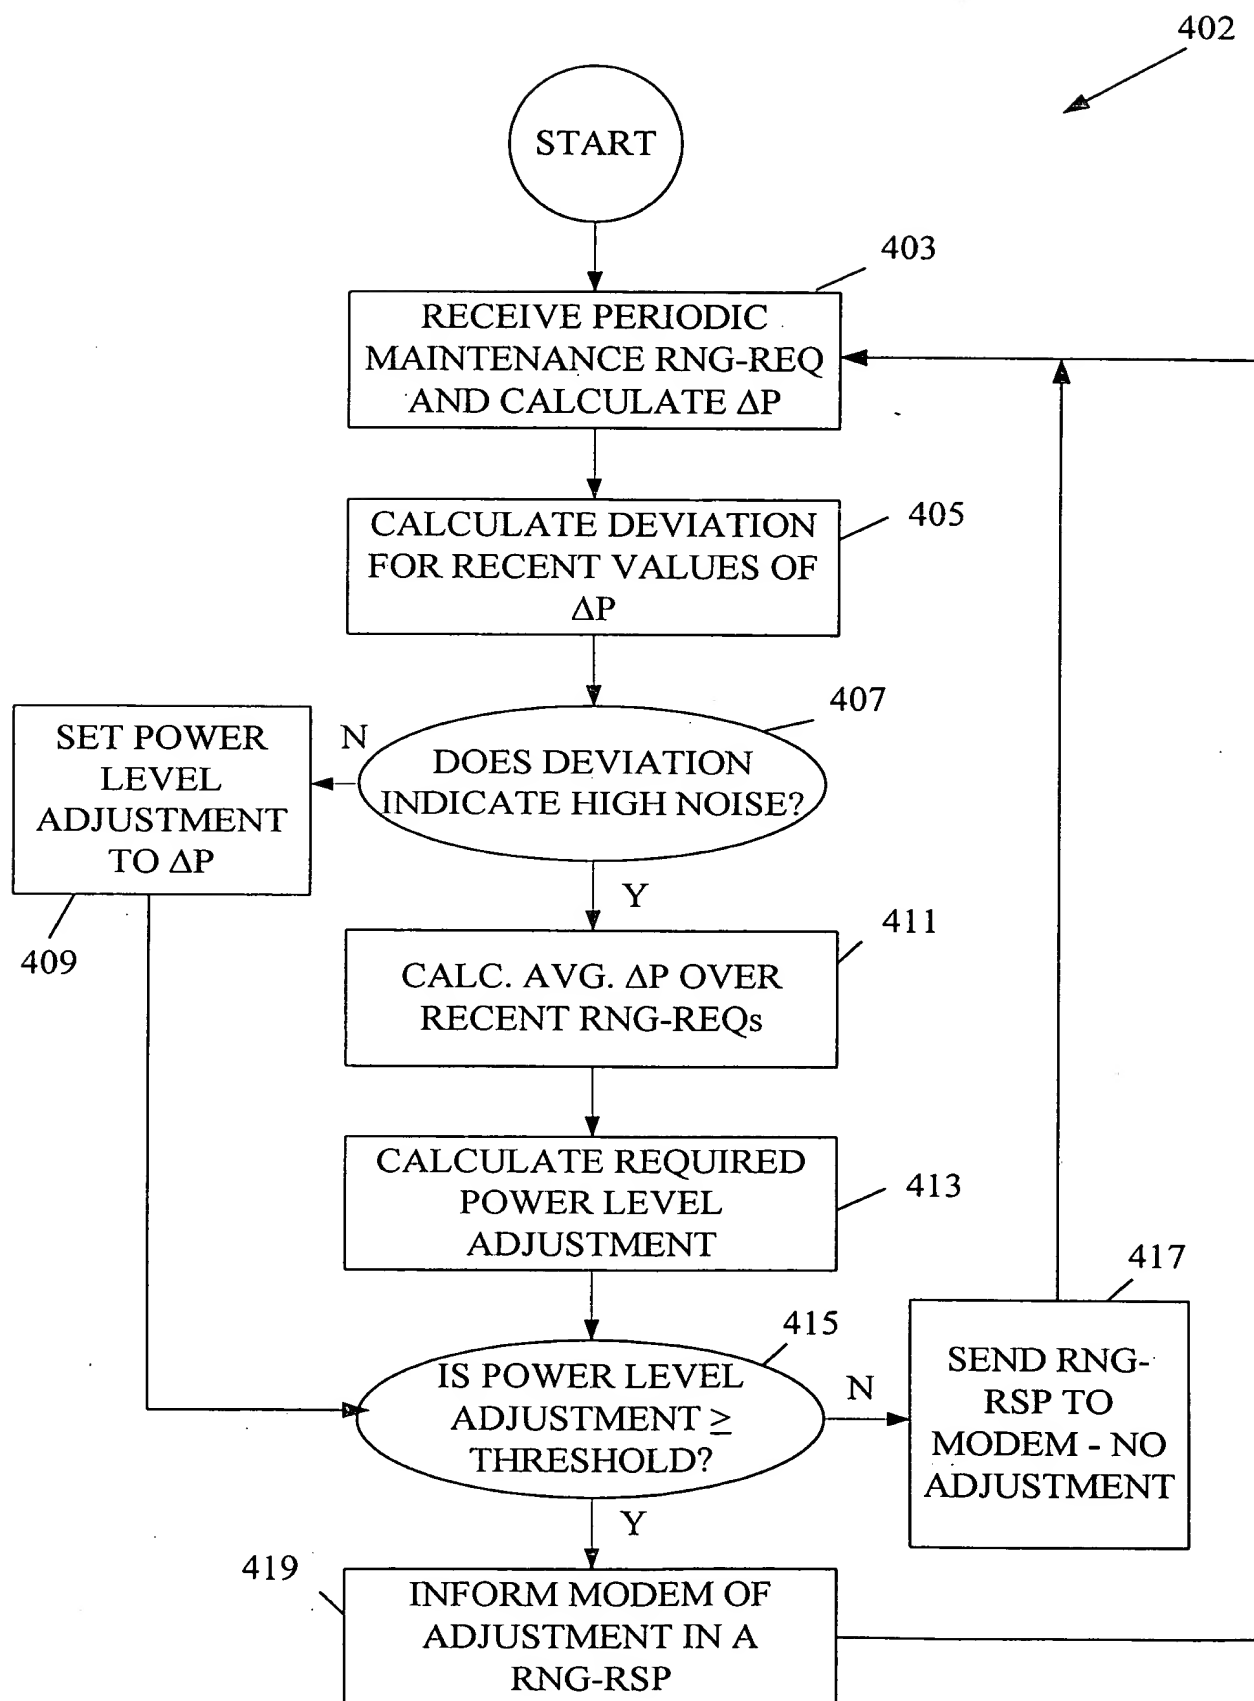


Figure 4

503



Signal/Noise	Power Level Adjustment
24.00 dB	0 dBmV
23.24 dB	- 0.5 dBmV
21.74 dB	- 1.5 dBmV
20.38 dB	- 2.4 dBmV
19.17 dB	- 3.2 dBmV
18.11 dB	- 3.9 dBmV
17.21 dB	- 4.5 dBmV
16.45 dB	- 5.0 dBmV
16.00 dB	- 5.3 dBmV

Figure 5

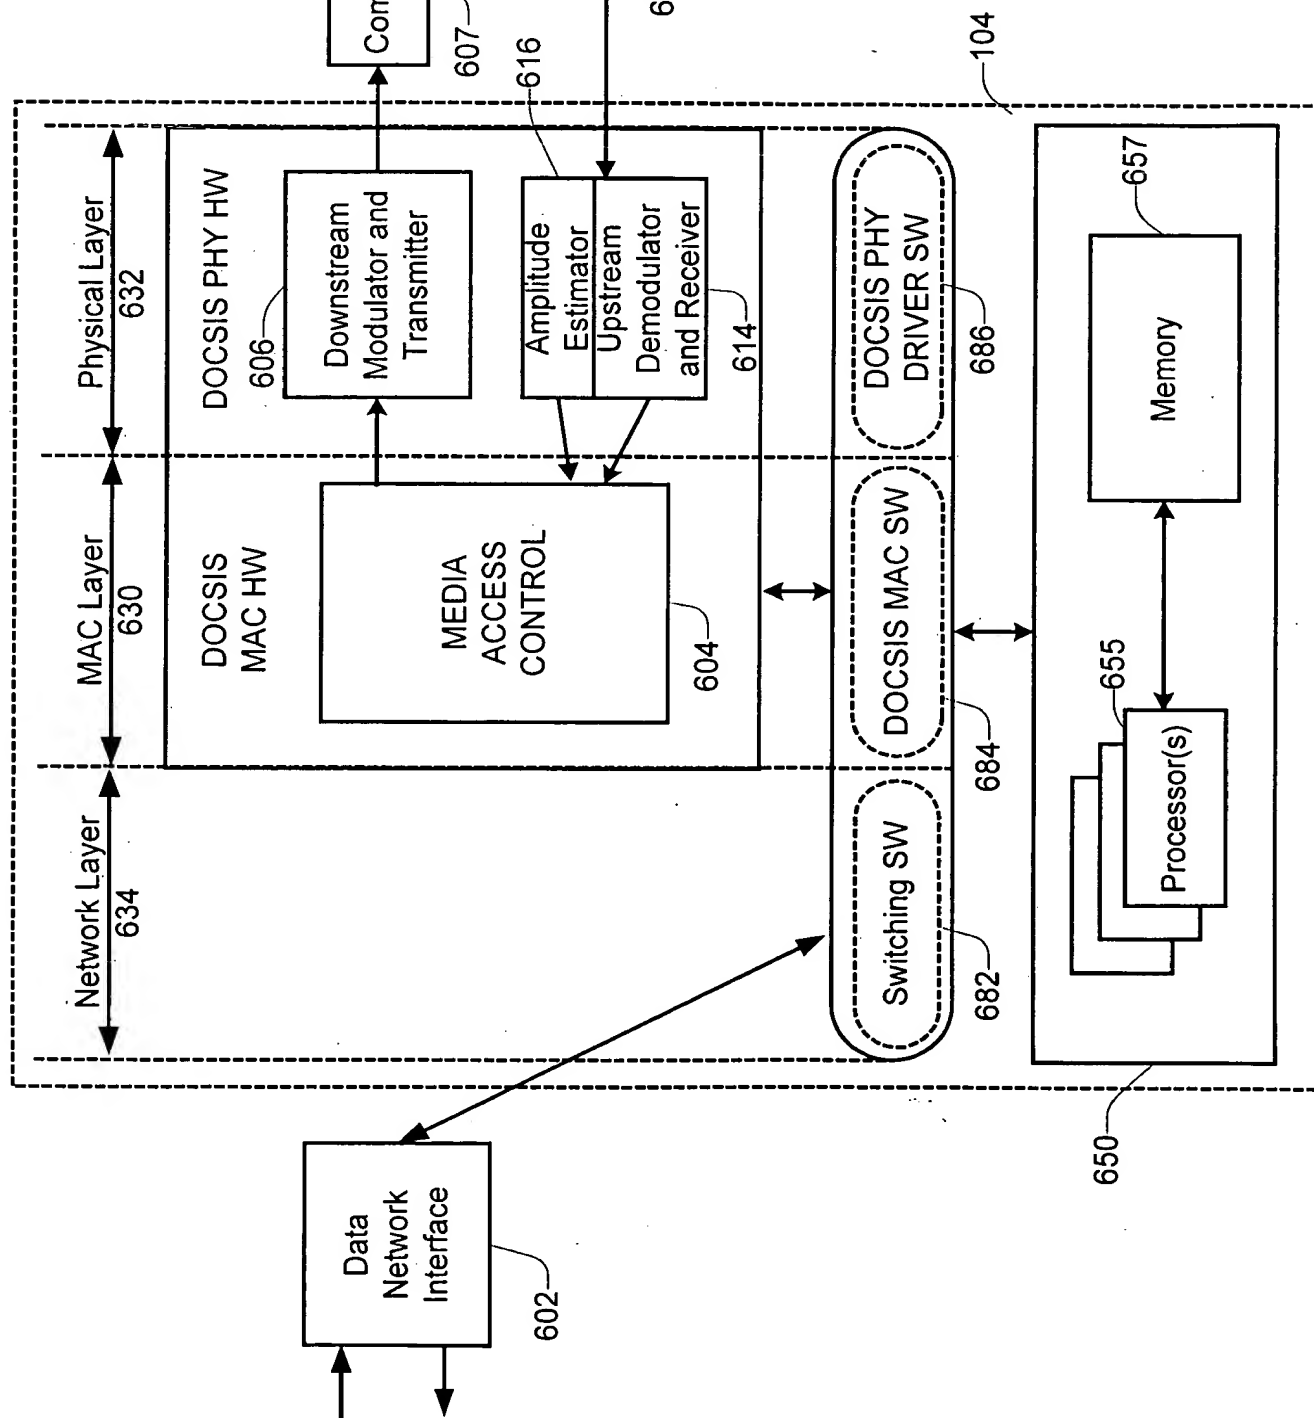


Figure 6